
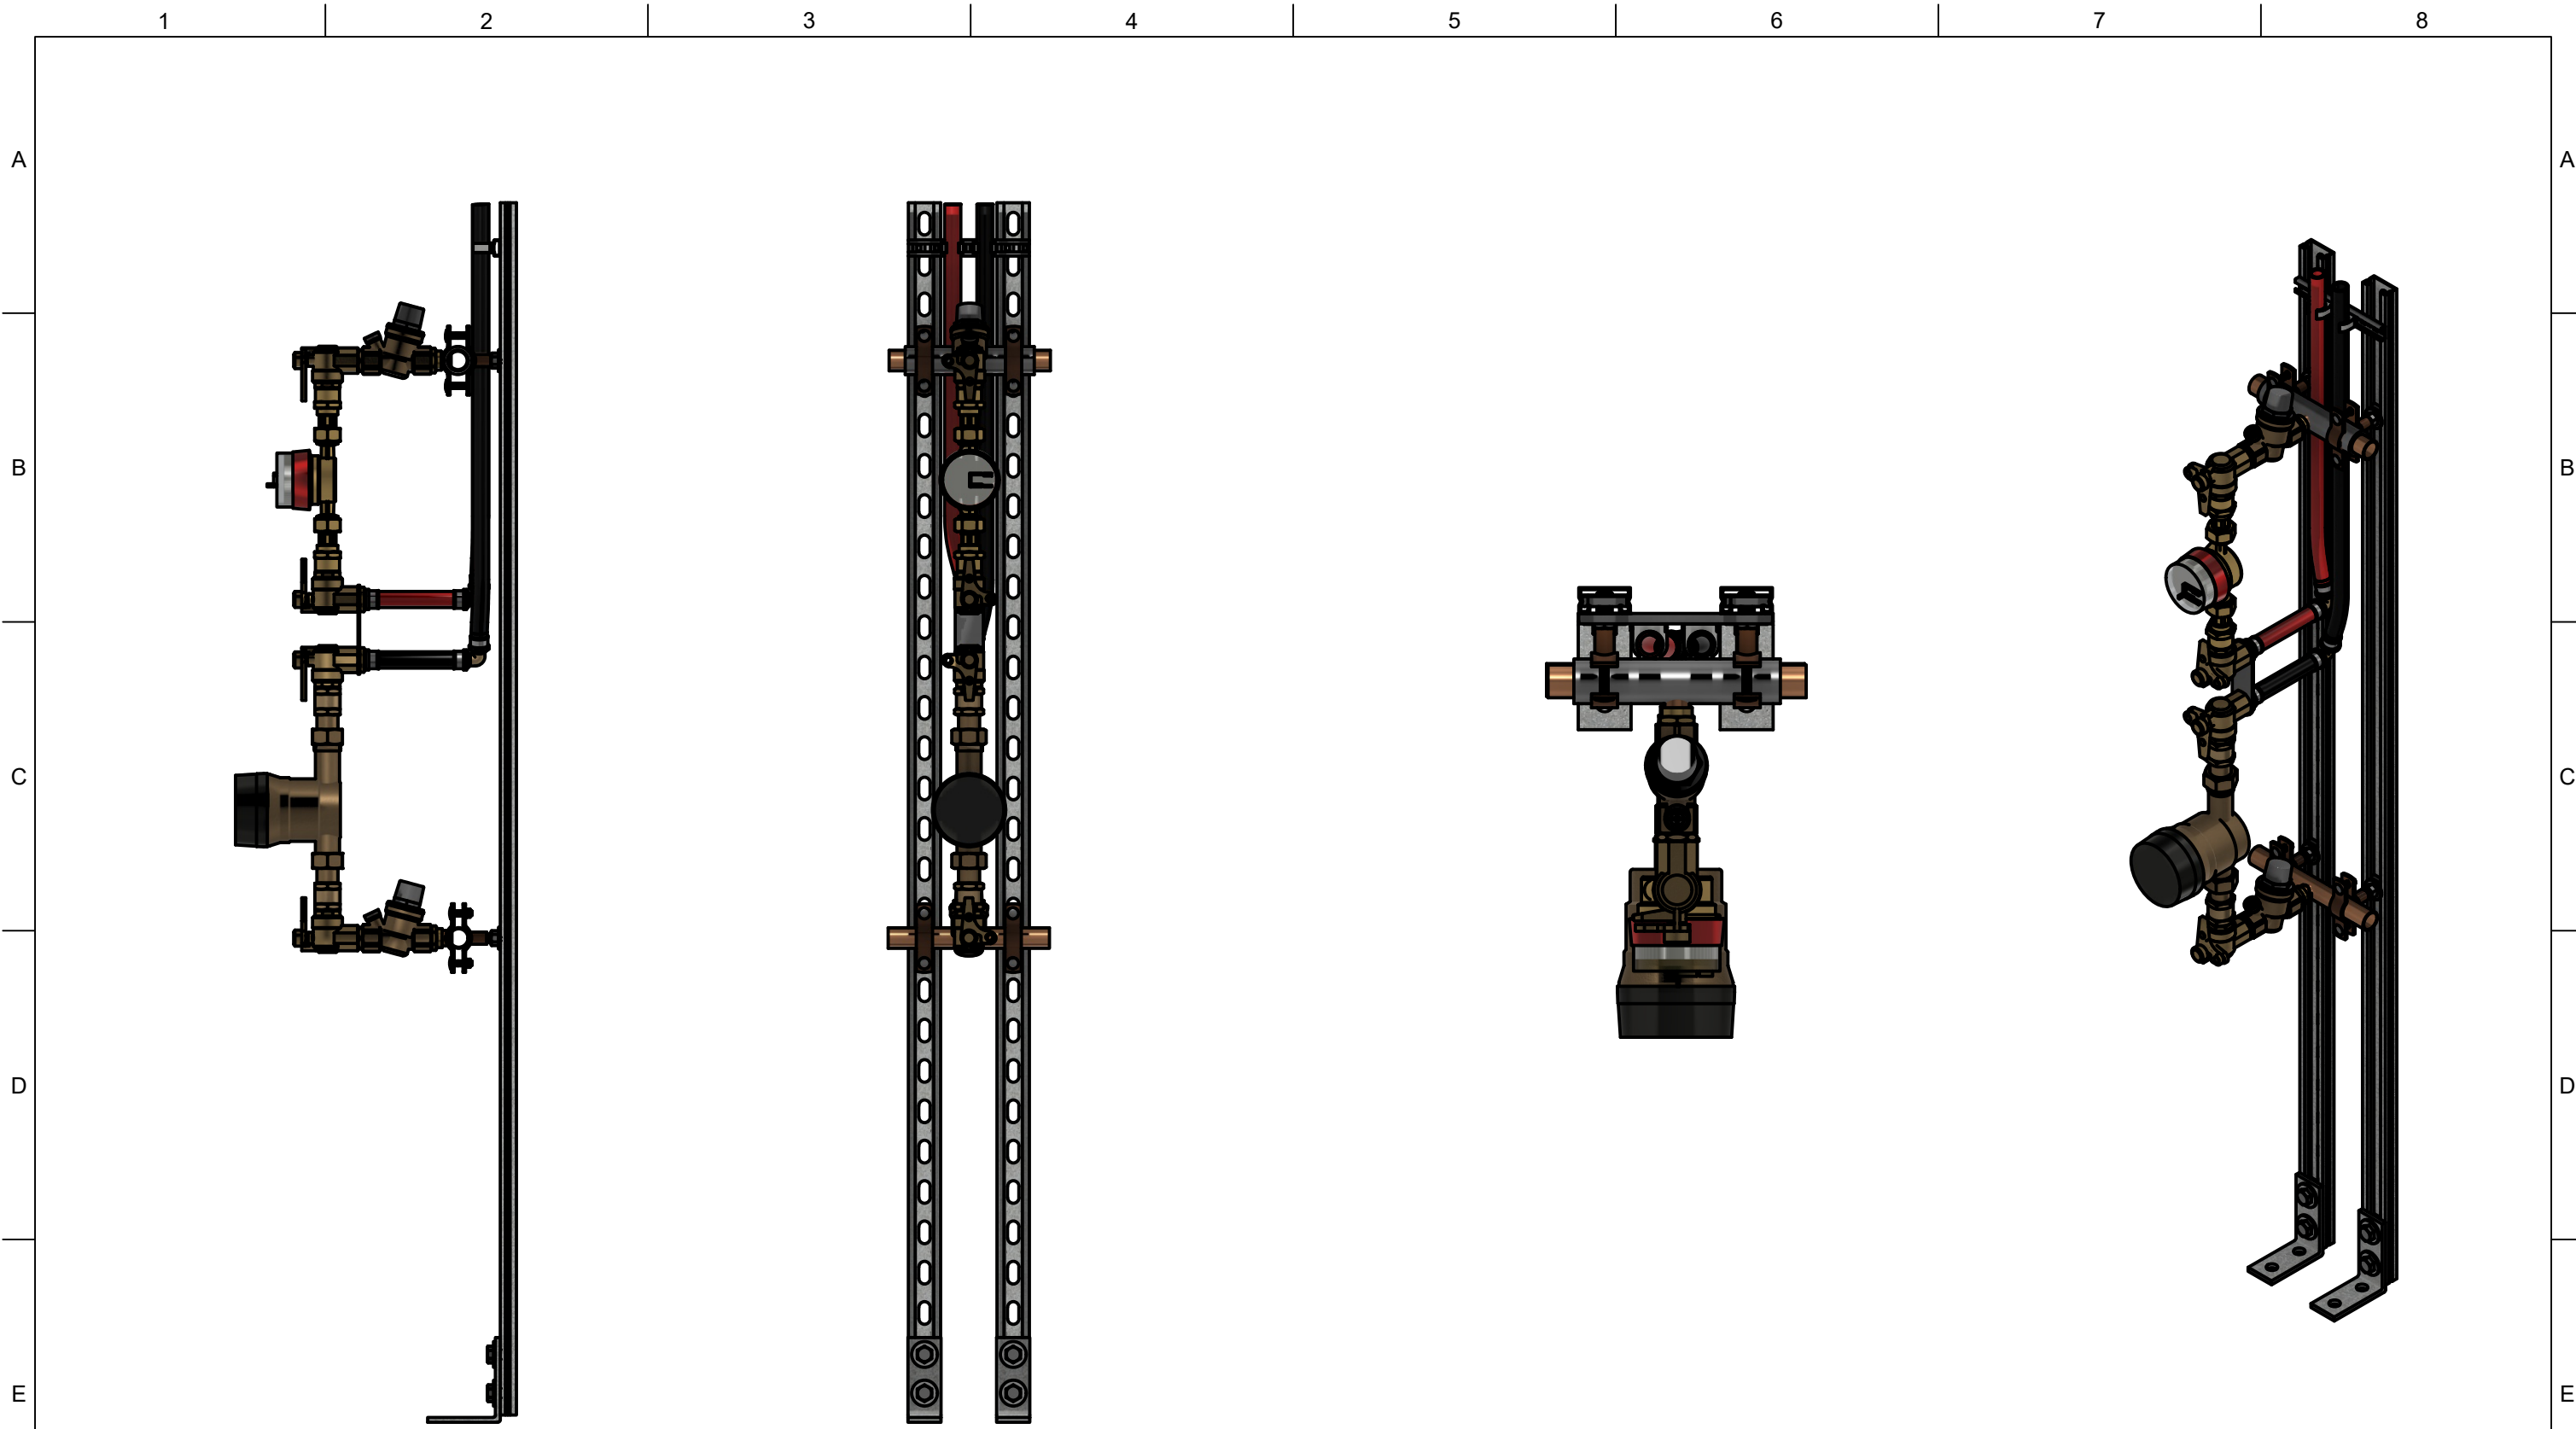


**SUB-METERING SPATIAL REQUIREMENTS**


Installation regulations for individual Cold Water Sub-Meters require 150mm clearance from the centre of each meter to other meters, walls or pipework. The above dimensions are specific to this meter setup.

 <p><b>SmartLink</b> — METERING SYSTEMS —</p> <p>Notes</p> <ul style="list-style-type: none"> <li>All measurements are in mm.</li> </ul>	Project <b>SmartLink</b>	Model No. <b>Spatial 2.HCWMF.NoTV.25.Vert</b>	Date of issue <b>8/02/2026</b>
	Client	Description <b>1 Hot &amp; Cold Water Frame - No TV</b>	Scale <b>1:8</b>
	Contact	Created by <b>Arin de Mestre</b>	Sheet <b>1/2</b>
This drawing remains the property of deFOX Industries Pty Ltd and may not be reproduced in full or part without the written consent of deFOX Industries.			



**SUB-METERING SPATIAL REQUIREMENTS**

Installation regulations for individual Cold Water Sub-Meters require 150mm clearance from the centre of each meter to other meters, walls or pipework. The above dimensions are specific to this meter setup.

	Project <b>SmartLink</b>	Model No. <b>1.HCWMF.25.NoTV v3</b>	Date of issue <b>8/02/2026</b>	
	Client	Description ----	Scale <b>1:8</b>	
Notes • All measurements are in mm.	Contact	Created by <b>Arin de Mestre</b>	Sheet <b>2/2</b>	Rev.
This drawing remains the property of deFOX Industries Pty Ltd and may not be reproduced in full or part without the written consent of deFOX Industries.				