

1 2 3 4 5 6 7 8

A




B

C

D

E

F

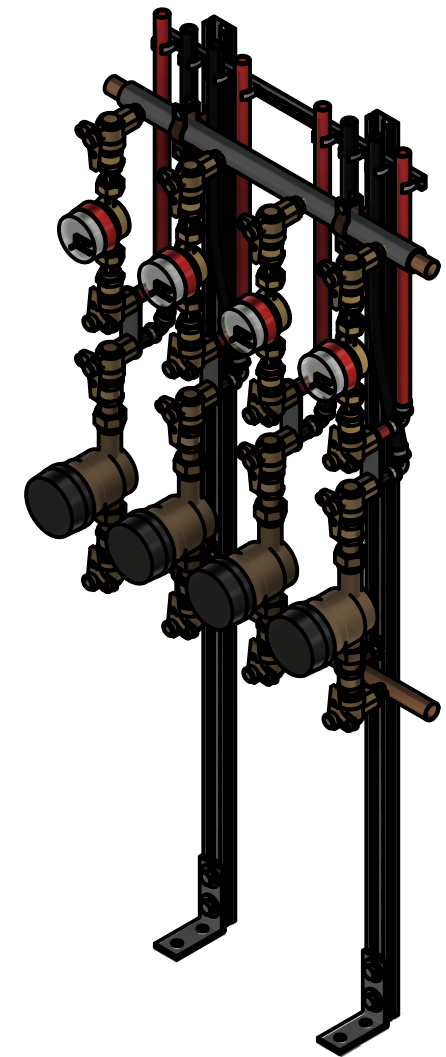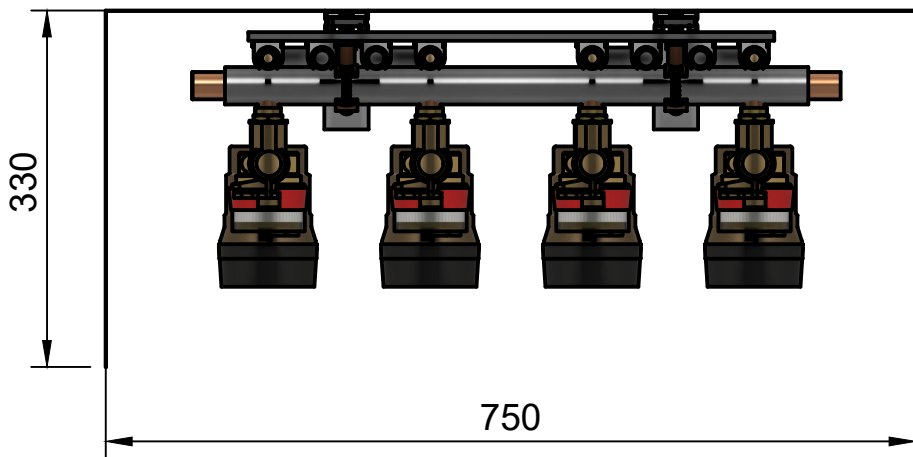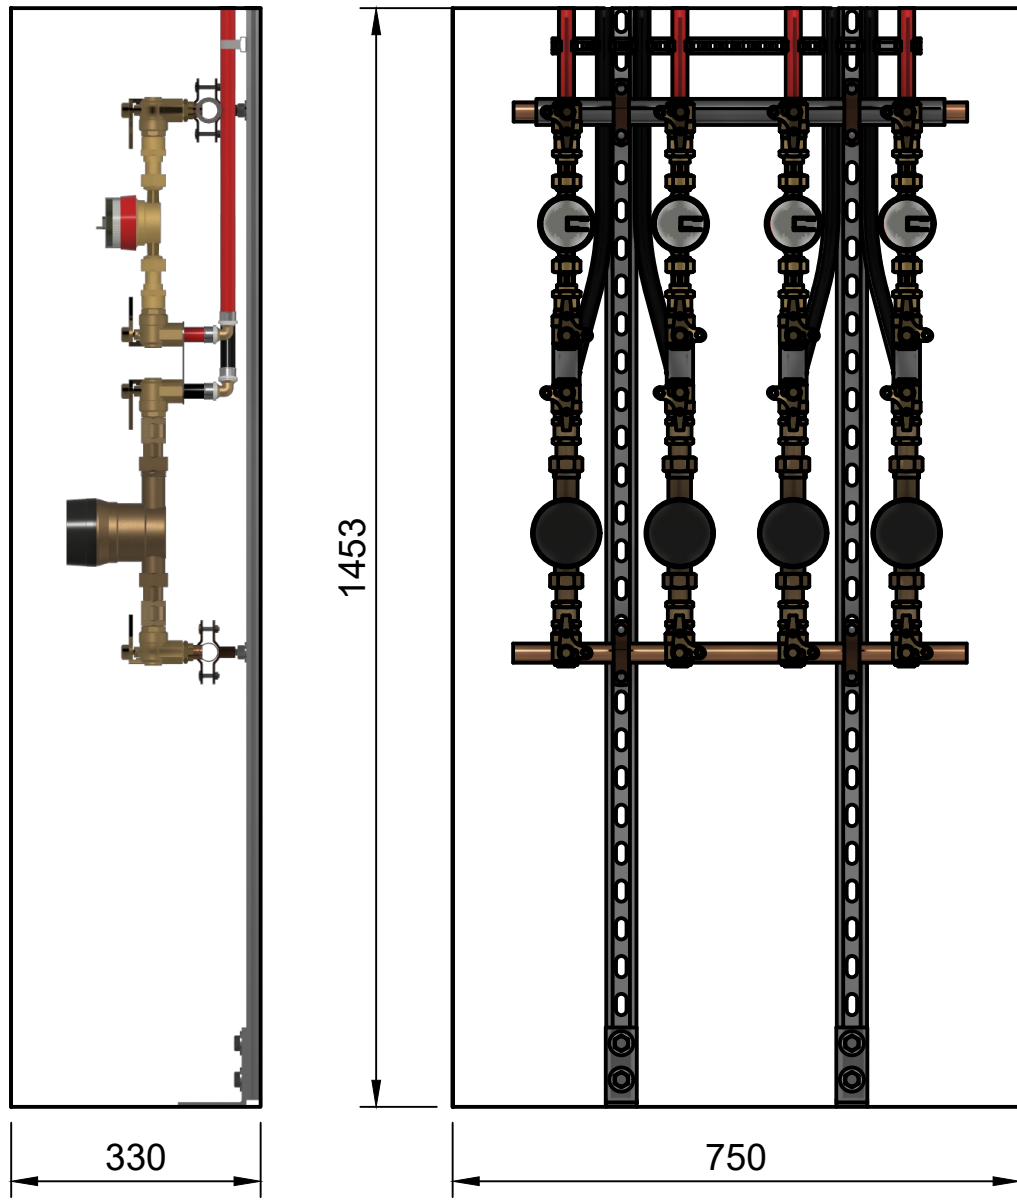

A

B

C


D

E

F

**SUB-METERING SPATIAL REQUIREMENTS**

Installation regulations for individual Cold Water Sub-Meters require 150mm clearance from the centre of each meter to other meters, walls or pipework. The above dimensions are specific to this meter setup.

 <p><b>SmartLink</b> — METERING SYSTEMS —</p> <p>Notes</p> <ul style="list-style-type: none"> <li>All measurements are in mm.</li> </ul>	Project <b>SmartLink</b>	Model No. <b>Spatial 4.HCWMF.NoTVPRV.25</b>	Date of issue <b>9/02/2026</b>
	Client	Description <b>4 Hot &amp; Cold Water Frame - No TV &amp; PRV</b>	Scale <b>1:7</b>
Contact	Created by <b>Arin de Mestre</b>	Sheet <b>1/1</b>	Rev.
This drawing remains the property of deFOX Industries Pty Ltd and may not be reproduced in full or part without the written consent of deFOX Industries.			

1 2 3 4 5 6 7 8