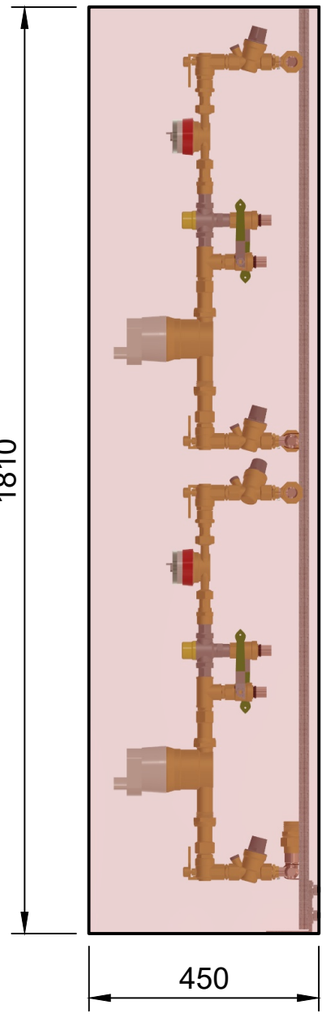

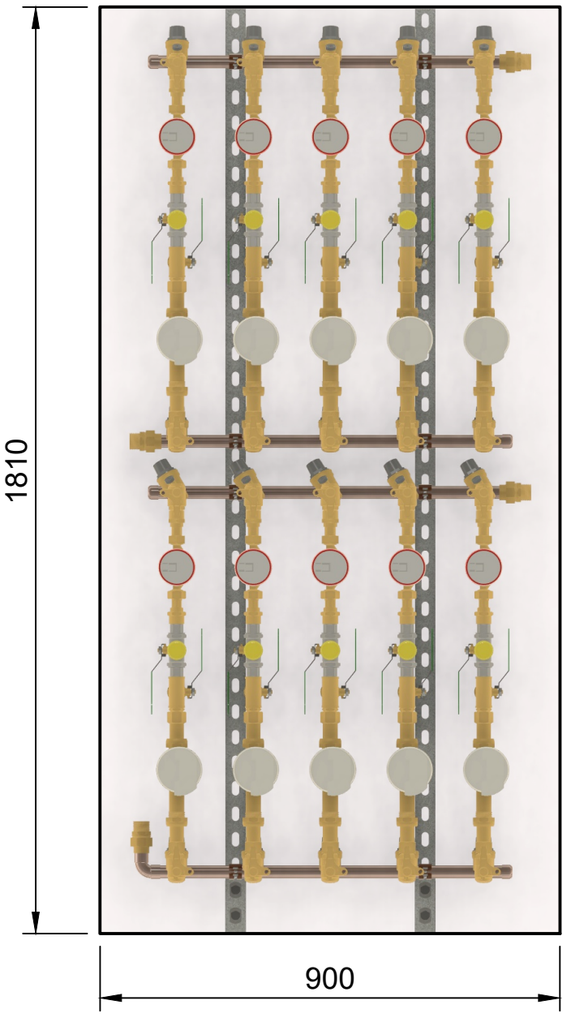

SUB-METERING SPATIAL REQUIREMENTS

Installation regulations for individual Cold Water Sub-Meters require 150mm clearance from the centre of each meter to other meters, walls or pipework.

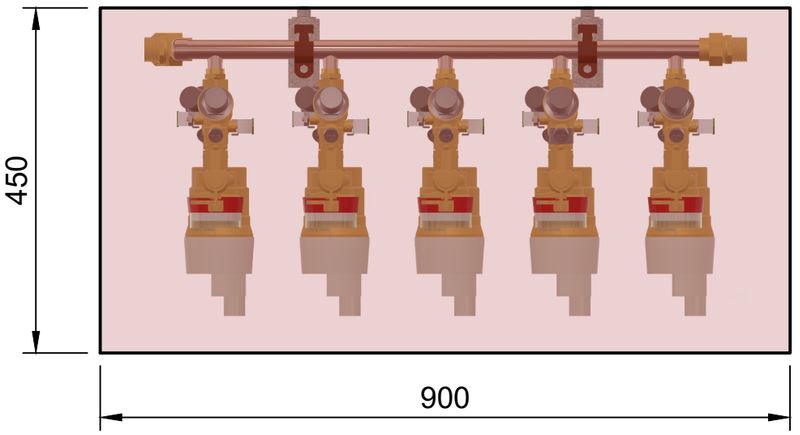

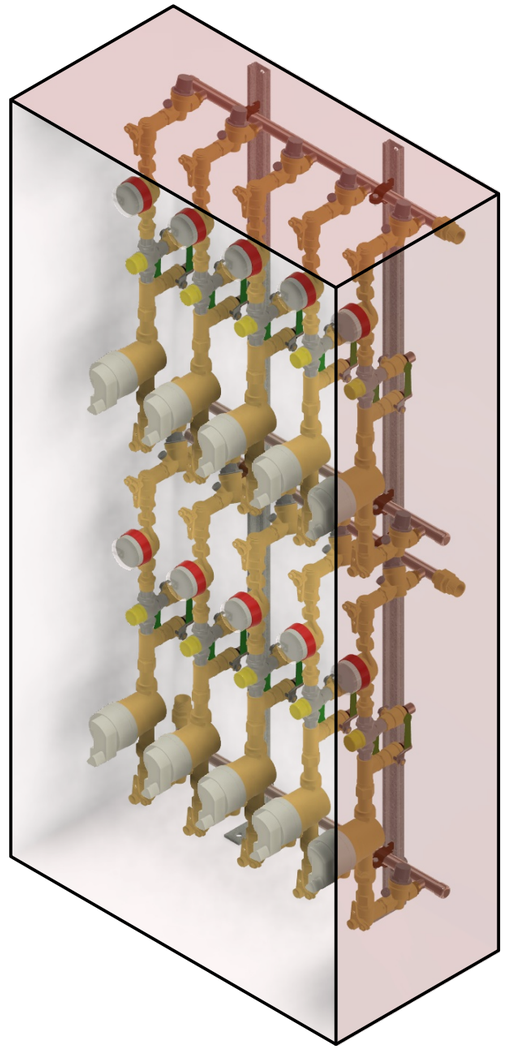

SMARTLINK NOTES

- All drawings detail All Valve Industries meters (iTron TD8 and All Valve GSD5). A breech peice between couplings is supplied at time of dispatch from deFOX Industries. Meters are not supplied by deFOX Industries.
- All drawings detail manifolds with a 25mm Ø as standard. Other Ø manifolds are available upon request. Large manifolds will increase the overall depth.

SmartLink METERING SYSTEMS

Notes
- All measurements are in mm.

Project: SmartLink	Model No.: Spatial 9-10.HCWMF.25	Date of issue: 22/06/2025	
Client	Description: 9 to 10 Hot & Cold Water Sub-Metering Frame	Scale: 1:20	
Contact	Created by: Arin de Mestre	Sheet: 1/1	Rev.

This drawing remains the property of deFOX Industries Pty Ltd and may not be reproduced in full or part without the written consent of deFOX Indsutries.