

1 2 3 4 5 6 7 8

A




B

C

D


E

F

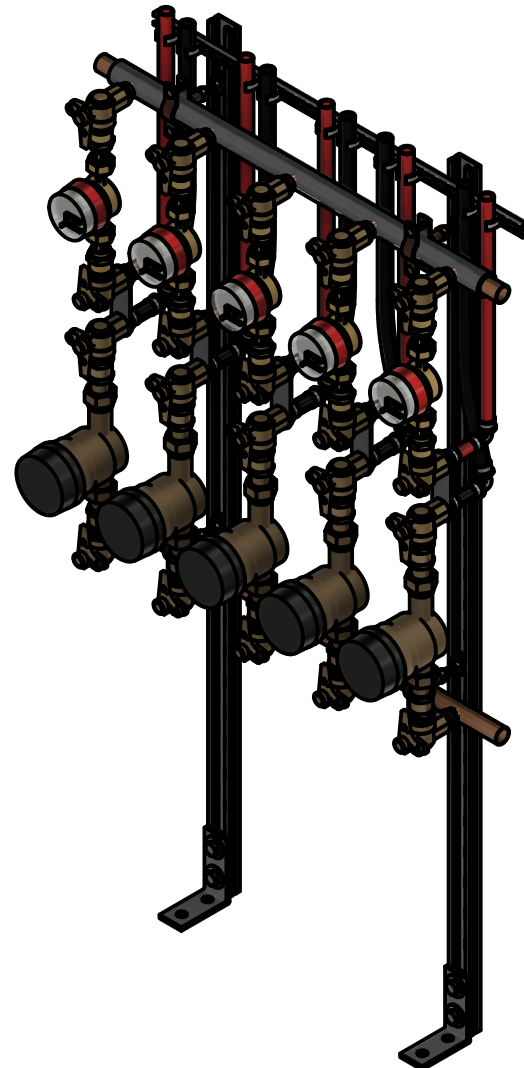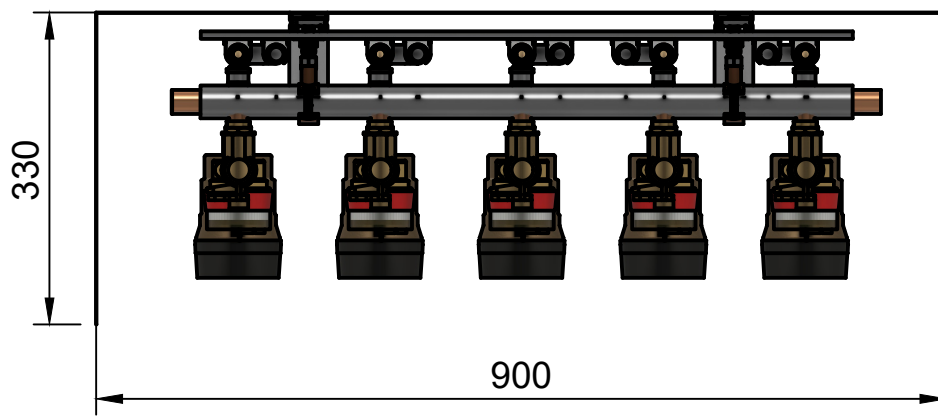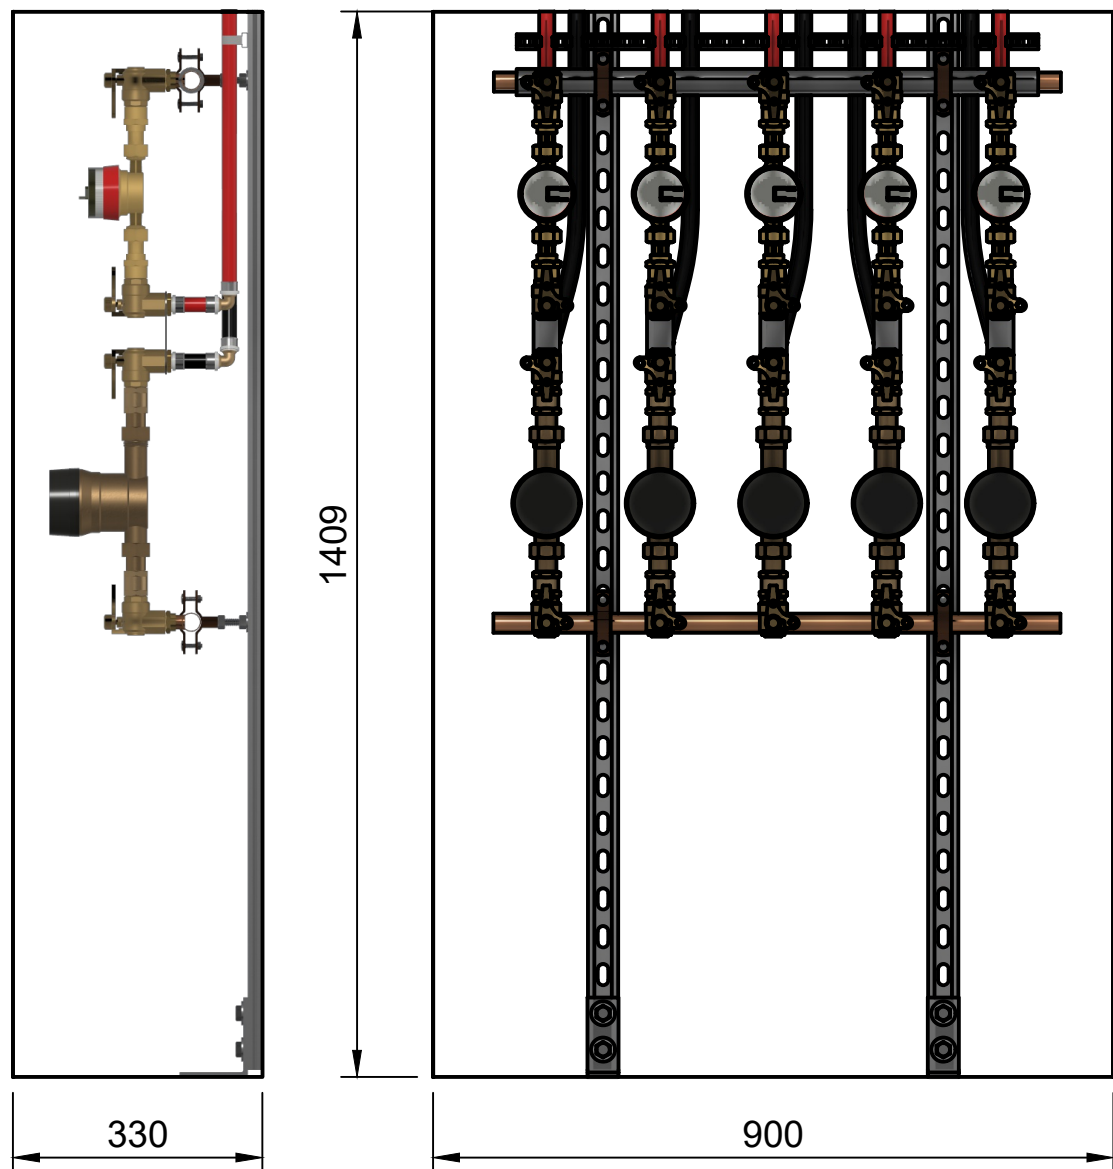

**SUB-METERING SPATIAL REQUIREMENTS**

Installation regulations for individual Cold Water Sub-Meters require 150mm clearance from the centre of each meter to other meters, walls or pipework. The above dimensions are specific to this meter setup.

 <p><b>SmartLink</b> — METERING SYSTEMS —</p>	Project <b>SmartLink</b>	Model No. <b>Spatial 5.HCWMF.NoTVPRV.25</b>	Date of issue <b>9/02/2026</b>	
	Client	Description <b>5 Hot &amp; Cold Water Frame - No TV &amp; PRV</b>	Scale <b>1:10</b>	
Notes • All measurements are in mm.	Contact	Created by <b>Arin de Mestre</b>	Sheet <b>1/1</b>	Rev.
This drawing remains the property of deFOX Industries Pty Ltd and may not be reproduced in full or part without the written consent of deFOX Industries.				

1 2 3 4 5 6 7 8

A

B

C

D

E

F